



ULTRASONIC LEVEL METERS ULM-53

ULTRASONIC LEVEL SENSORS ULS-53

TABLE OF CONTENTS

1. Safety	4
2. Packing, transportation and storage	4
3. Measuring principle	5
4. Range of application	5
5. Features of variants.....	5
6. Dimensional drawings.....	6
7. Installation and putting into operation	6
8. Installation instructions	7
9. Electrical connection.....	11
10. Set-up elements	14
11. Status indication.....	15
12. Setting.....	16
12.1. Setting procedure for level meters ULM-53.....	17
12.2. Setting procedure for level sensors ULS-53.....	19
13. Protocol Modbus.....	21
14. Order code.....	21
15. Accessories.....	22
16. Safety, protection, compatibility and explosion proof design	22
17. Use, operation and maintenance	23
18. General conditions and warranty.....	23
19. Marking of labels	24
20. Specifications	25

USED SYMBOLS

In order to provide maximum safety of processes, we have defined the following safety and information instructions. Each of the instructions is marked with an icon.



Alert, warning, danger

This symbol informs about particularly important instructions for installation and operation of the equipment or about dangerous situations that may occur during installation and operation. Failure to comply with the instructions may cause failures, damage or destruction of the equipment, or may cause injuries to persons.



Information

This symbol informs about particularly important characteristics of the equipment.

1. SAFETY



Any operations described in this User's Guide may only be performed by trained personnel or by an authorized person. Warranty and post-warranty repairs shall be performed exclusively on the manufacturer's site.

Improper use, installation or setting of the level meter may lead to crashes in the application (overfilling of the tank or damage to system components).

The manufacturer is not responsible for improper use, work losses resulting from direct or indirect damage and expenses incurred during installation or use of the level meter.

2. PACKAGING, TRANSPORT AND STORAGE

The ULM-53 or ULS-53 device is packed in a cardboard packaging and the whole shipment is placed in a cardboard box. The cardboard box is suitably filled to prevent mechanical damage during transport.

Remove the device from the package just prior to its use to prevent possible damage.

Transport to the customer is provided by a forwarding company. Subject to prior arrangement, personal pick-up of the ordered goods is possible in the company's seat. Upon receipt, please check whether the shipment is complete and corresponds to the extent of the order, or whether during the transport the packaging and the device has not been damaged. Do not use a device apparently damaged during transport and contact the manufacturer to resolve the situation.

If the device is transported further, it shall be wrapped in the original packaging and protected against shocks and weather.

Store the device in its original packaging in a dry place, sheltered from weather, with humidity up to 85% without the effects of chemically active substances. The range of storage temperature is -20°C to +60°C.



Level meters (sensors) of variants ULM (ULS)-53_-01, 02, 06, 10 are fitted with protective caps to prevent damage to the ultrasonic transducer. Remove the caps before commissioning!

3. MEASURING PRINCIPLE

The ULM® ultrasonic level meters and the ULS® ultrasonic level sensors are compact measurement devices containing an electro-acoustic transducer and an electronic module. Using the electro-acoustic transducer, level meters and level sensors transmit a series of ultrasonic pulses that spread towards the surface. The transducer then receives the reflected acoustic wave, which is subsequently processed in the electronic module. The current distance to the surface level is calculated from the time of spread of individual pulses towards the surface and back and the temperature measured in the tank. The output is then set on the basis of the surface height. The outputs of the ULM level meter are current 4 -20 mA, voltage 0 - 10 V and industrial line RS-485 with Modbus RTU communication. The output of the ULS sensor consists of a PNP transistor with an open collector and a two-state current switch 4 mA / 20 mA.

4. RANGE OF APPLICATION


Thanks to the proximity principle employed, the devices are suitable for continuous or limit measurement of the level of liquids, waste water, sludge, suspensions, adhesives, resins in various open and closed vessels, sumps, open channels and drains. Applicability for measuring the surface level of loose materials is limited, the range of measurement is shorter there. Setting is carried out either using two buttons or a magnetic pen or by remote setting in case of Modbus RTU output. The device is equipped with optical indication of its state (RUN) and the setting process (STATE). It is manufactured in designs for normal (N) and explosive atmospheres (Xi).

5. FEATURES OF VARIANTS


- UL_-53_-01_-** measurement range **0.1 m to 1 m**, all-plastic design, source of PVDF (polyvinylidene fluoride), mechanical connection with thread G ¾.
- UL_-53_-02_-** measurement range **0.20 m to 2 m**, all-plastic design, source of PVDF, mechanical connection with thread G 1".
- UL_-53_-06_-** measurement range **0.20 m to 6 m**, all-plastic design, source of PVDF, mechanical connection with thread G 1 ½".
- UL_-53_-10_-** measurement range **0.4 m to 10 m**, all-plastic case, source of PVDF, mechanical connection with thread G 2 ¼".
- UL_-53_-20_-** measurement range **0.5 m to 20 m**, all-plastic case, source of PVDF, mechanical connection with flange of aluminium alloy.

6. DIMENSIONAL DRAWINGS


UL_-53_-01_-

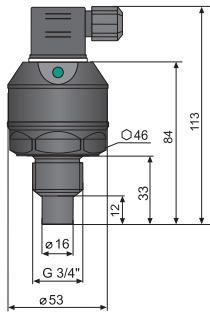


UL_-53_-02_-




UL_-53_-06_-

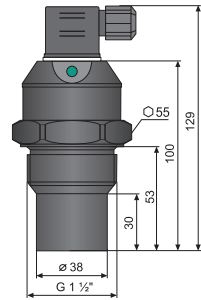

UL_-53_-10_-

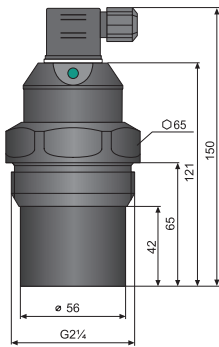

UL_-53_-20_-

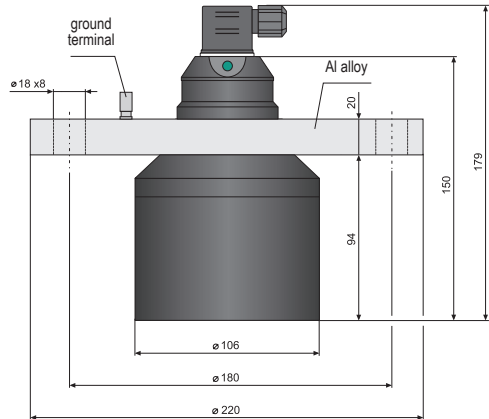

7. INSTALLATION AND PUTTING INTO OPERATION

This procedure includes the following three steps.

- **INSTALLATION**
- **ELECTRIC CONNECTION**
- **SETTING**

8. INSTALLATION INSTRUCTIONS

- The device is installed in a vertical position into the upper lid of the tank or reservoir using a lug, a fastening nut or a flange in such a way that the axis of the device is perpendicular to the surface level of the measured liquid (Fig. 1). Tightening of the level meter in the welding flange (or. by the fixing nut) **must be done only by hand** *. The device shall be installed in places with no risk of **mechanical damage to the front of the sensor**.
- The minimum distance from the tank wall when installing into the lid or the ceiling of the tank are listed in Fig. 3. In the case of device installation close to smooth wall of the tank it is not necessary to observe the minimum distance, conversely it is suitable to shorten this distance.
- When installing in an open channel (sump, drain, etc.), install the device onto a console as close as possible to the expected maximum level.
- The reference plane for the measurement is the lower edge of the transducer (Fig.2). In compliance with the measuring principle, no signals **reflected in the area directly below the device** (dead zone) can be evaluated. The dead zone (Fig. 2) determines the minimum distance possible between the device and the highest level. The minimum distances to the medium are listed in the chapter "Technical specifications".
- The device shall be installed so that the surface does not interfere with the dead zone when the tank is filled to the maximum. If the measured surface interferes with the dead zone, the device **will not measure properly**.




Fig. 1: Correct installation of the sensor, perpendicular to the liquid surface

UL_-53-01;02;10	$d > c/12$ (min. 200 mm)
UL_-53-06	$d > c/8$ (min. 200 mm)
UL_-53-20	$d > c/10$ (min. 200 mm)

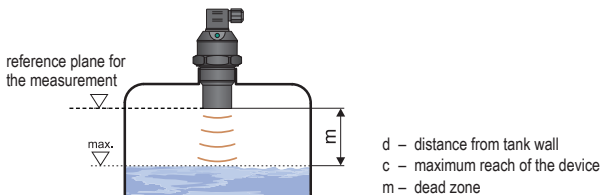


Fig. 2: Dead zone of the device




Fig. 3: Distance of the device from the tank wall

- Do not install the device in or above the **filling point** (Fig. 4). The measurement could be affected by the inflowing medium.

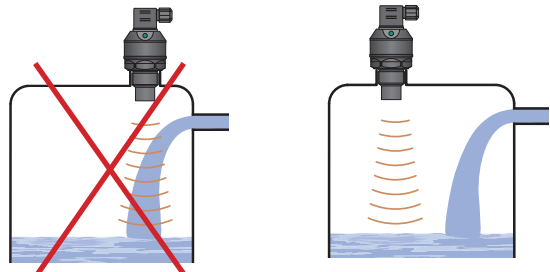


Fig. 4: Installation of the device out of reach of filling circulation

*) To loosen the level meter can be used suitable wrenche.



It is recommended to avoid placing the sensor into a narrow inlet.

- Only if the maximum level in the tank gets into the dead zone, the device shall be mounted to a higher **installation neck**. The tank can be then filled nearly up to the maximum volume. The neck's inner surface shall be even and smooth (without edges and welded joints), the inner edge should be rounded in the spot where the ultrasonic wave leaves the pipe. Choose the largest possible neck diameter, but keep the neck height as low as possible. The recommended dimensions of the inlet neck are listed in Fig. 5.

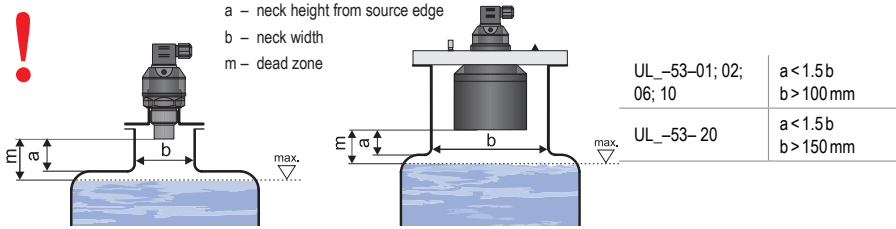


Fig. 5: Installation of the device in the installation neck

- If the level sensor is mounted to bottlenecks and places with barriers, or near uneven walls or the filling area, where the transmission signal could be distorted, we recommend using a guide tube (acoustic horn). The tube must be made from a single material with a smooth inner surface (see image 6 a 7). The minimum tube diameter must have the dimension „h“ according to see to table at image 7. The construction of the guide tube we recommend to consult with the manufacturer.

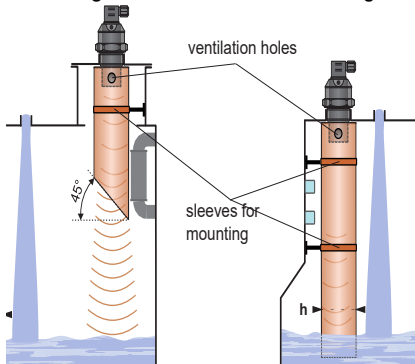


Fig. 6: Short guide tube installation

Fig. 7: Total guide tube installation

UL_–53–01	h ≥ 50 mm
UL_–53–02	h ≥ 70 mm
UL_–53–06	h ≥ 100 mm
UL_–53–10	h ≥ 150 mm
UL_–53–20	h ≥ 200 mm

- Horn adapter ST–G0,75 (for ULM–53_–01), ST–G1 (for ULM–53_–02), ST–G1,5 (for ULM–53_–06) or ST–G2,25 (for ULM–53_–10) for improved reception of the transmitted signal can be used in open channels, sumps, tanks, etc.
- Horn adapter ST increases the directivity of the emitted acoustic waves, improves the reception of weak echoes (unstable surface level, loose materials, foam on the level) and reduces the risk of falsereflections.
- The horn adapter is installed on the device via process connection G3/4" (ST–G0,75) or G1" (ST–G1) or G1½" (ST–G1,5), or G 2 ¼" (ST–G2,25).

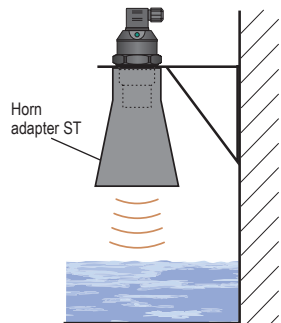


Fig. 8: Horn adapter installation

- The site for installing the level meter needs to be chosen so that the emitted acoustic signal is not affected by **nearby objects** (reinforcements, supports, brackets, ladders, heating elements, mixers, etc.). These obstacles may result in false rebounds, increasing measurement inaccuracy (Fig. 9).

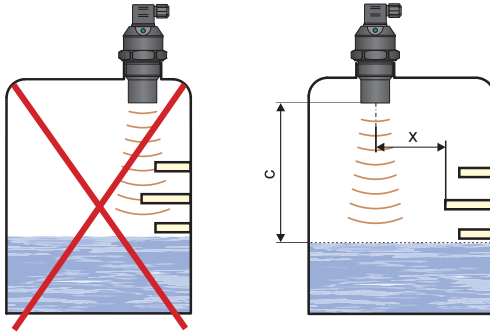


Fig. 9: Minimum distance from close objects in the tank

UL_53-01;02;10	$x > c/12$ (min. 200 mm)
UL_53-06	$x > c/8$ (min. 200 mm)
UL_53-20	$x > c/10$ (min. 200 mm)

x – distance from the edge of the longest object

c – maximum reach of the level meter

- Foam may be produced on the surface of the measured liquid during filling, mixing and other processes. The thick foam significantly absorbs the ultrasound signal and may cause malfunction of the device (Fig. 10). In those cases it is necessary to test the device in advance or contact the manufacturer. In case of a thin layer of foam, it is also possible to use directional horn for improving receipt of the reflected echo.




Fig. 10: Thick foam on the surface

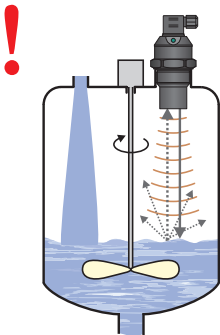


Fig. 11: Moderately stirred surface

- The ultrasonic signal can be scattered or attenuated if the surface is moderately stirred or rippled (due to a mixer, inflow of liquid, etc.). This may result in **reduction of the measurement range** or unreliable operation of the device (Fig. 11). **For a rippled or swirling level, you can use the directional horn to eliminate scattering of the ultrasonic signal.**

- False surface reflections of the ultrasonic signal and unreliable operation of the device might result from the mixer's **rotating blades** that ripple the surface level (Fig. 12).
- The device should not be installed in places with the risk of **false reflections** of the ultrasonic signal from the mixer's blades (Fig. 13).

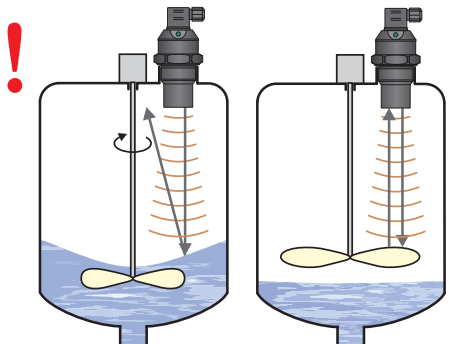


Fig. 12: Strongly stirred surface Fig. 13: False reflection from mixer blades

- In case the level of bulk solids is measured, the measurement range is reduced due to absorption of acoustic waves by a bulk medium. Shortening of the measuring range occurs by up to 50% depending on the grain size. We therefore recommend selecting a level meter with higher range than the maximum distance to the medium. It is also appropriate to use a directional horn (see image 14), which reduces the shortening of the measuring range, because it better concentrates acoustic energy while preserving the same beam angle, and improves the sensitivity when receiving the reflected echo. We recommend to consult the use with the manufacturer.

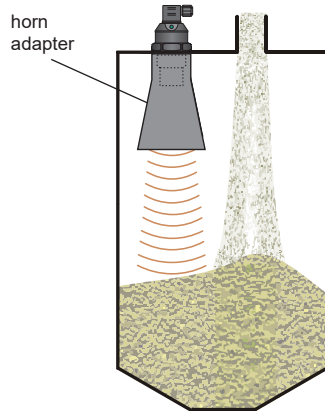


Fig. 14: Level meter installation in silo or hopper

- The measuring device **shall not be installed** in places with direct sunlight and shall be protected against weather conditions. **Direct sunlight affects the built-in temperature compensation!**
- If installation in places with direct sunlight is inevitable, it is necessary to mount a **shielding cover** above the device (Fig. 15).

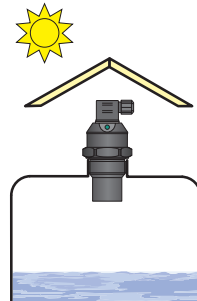


Fig. 15: Shielding cover against direct sunlight

- It is advisable to keep cable under the **cable gland** (sagging down) as shown in Fig. 16 to prevent penetration of moisture. Rain and condensing water can be therefore drained away freely.
- The cable gland as well as the connector shall be **tightened sufficiently** to prevent penetration of moisture.




Fig. 16: Protection against penetration of moisture




In the case of use for an aggressive medium is necessary to prove the chemical compatibility of used materials of the sensor (Tab. Used materials on page 26). The guarantee ceases when the product is chemically damaged.

9. ELECTRIC CONNECTION

Connection through ISO connector

The ULM level meter or ULS level sensor with a G type cable gland are connected to processing (display) units by means of a cable with an outer diameter of 6 to 8 mm (recommended wire cross-section 0.5 to 0.75 mm²), via a detachable ISO connector with inner screw terminals, which is part of the delivery. The connection diagram and the inner view of the connector are shown in Fig.17 and 18. Non-detachable connector IP67 with PVC cable 5 m long can be supplied as an extra option.

Valid for: UL_-53_-_-_-G-



Performance „G“
with connector ISO

Connecting the cable to the device:

1. Unscrew the connector from the device body using a suitable screwdriver.
2. Remove the inner part of the connector using a flat screwdriver (insert the screwdriver in the gap marked with an arrow).
3. Unscrew the cable gland and pull the supply cable inside the connector.
4. Connect the cable wires to the screw terminals as shown in Fig. 17 (current output 4-20 mA), Fig. 18 (voltage output 0-10 V), Fig. 19 (S type output) or Fig. 20 (P) type output. Tighten the terminals firmly.
5. Insert the terminals back in the connector so that the NC terminal points away from the cable gland. Fasten the cable gland.
6. Check the sealing on the connector and attach the connector back to the device body.

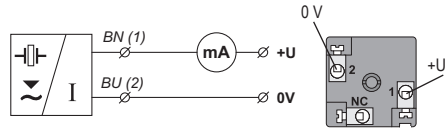


Fig. 17: Connection diagram of the ULM level meter (variant -I) and inside view of the connector

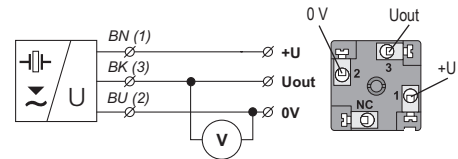


Fig. 18: Connection diagram of the ULM level meter (variant -U) and inside view of the connector

Type ULS-53_-_-_-S-G-

Positive supply pole +U is connected to the brown wire or to connector pin 1, negative pole to the blue wire or to connector pin 2.

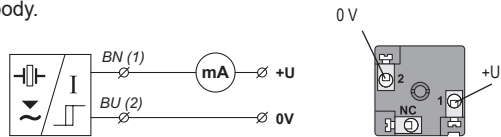


Fig. 19: Connection diagram of the ULS sensor with S type output (two-state current switch 4 mA / 20 mA)

Type ULS-53_-_-_-P-G-

Positive supply pole +U is connected to the brown wire or to connector pin 1, negative pole to the blue wire or to connector pin 2. Load is connected to the black wire or to connector pin 3.

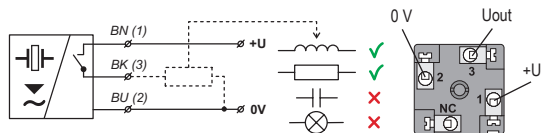


Fig. 20: Connection diagram of the ULS sensor with P type output (PNP) with an open collector

legend:

BK – black BN – brown
BU – blue NC – not connected

Connection through M12 connector

Valid for: UL_-53_-_-_-C-

The ULM level meter or ULS level sensor with a C type cable gland are connected to processing (display) units by means of a cable with an outer diameter of 4 to 6 mm (recommended wire cross-section 0.5 to 0.75 mm²), via a connector socket with a moulded cable (2 or 5 m long) or via a detachable connector socket without a cable (see accessories). In this case connect the cable to the inner socket pins under Fig. 21.


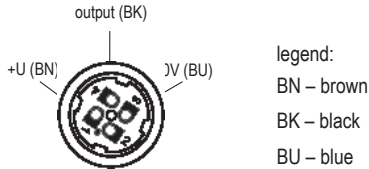


Fig. 21: Inside view of the connector socket



Performance, C
with connector M12

Type ULM-53_-_-_-I-C-

The positive supply pole +U is connected to connector pin 1 or the brown wire of the connected cable, the negative pole is connected to connector pin 3 or the blue wire of the connected cable.

Type ULM-53_-_-_-U-C-

The positive supply pole +U is connected to connector pin 1 or the brown wire of the connected cable, the negative pole is connected to connector pin 3 or the blue wire of the connected cable. Output voltage is connected to connector pin 4 or the black cable wire.

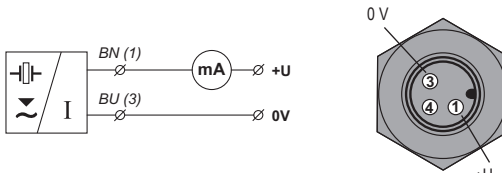


Fig. 22: Connection diagram of the ULM level meter (variant -I) and view of the connector

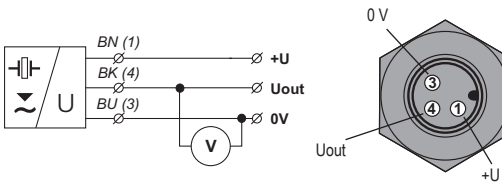


Fig. 23: Connection diagram of the ULM level meter (variant -U) and view of the connector

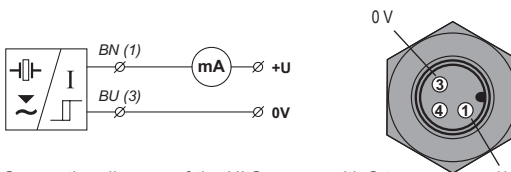


Fig. 24: Connection diagram of the ULS sensor with S type output (two-state current switch 4 mA / 20 mA)

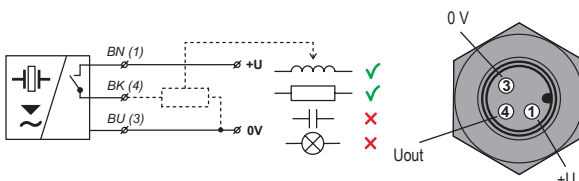


Fig. 25: Connection diagram of the ULS sensor with P type output (PNP) with an open collector

Type ULS-53_-_-_-S-C-

The positive supply pole +U is connected to connector pin 1 or the brown wire of the connected cable, the negative pole is connected to connector pin 3 or the blue wire of the connected cable.

Type ULS-53_-_-_-P-C-


The positive supply pole +U is connected to connector pin 1 or the brown wire of the connected cable, the negative pole is connected to connector pin 3 or the blue wire of the connected cable. Load is connected to connector pin 4 or the black cable wire.

UL_-53_ © Dinel, s.r.o.


**Connection via PG 11 gland
or gland for protective hoses**

Valid for: UL_-53_-_-_-B(H)-_

The ULM level meter or ULS sensor with a B or H type cable gland are connected to processing (display) units by means of a fixed PVC cable 5 m long. PG 11 (B) or plastic bushings with a thread for protective hoses (H) can be used as a cable gland. Connection diagrams are shown in Fig. 26, 27, 28, 29 and 30.



Performance „B“ with short cable gland



Performance „H“ with cable gland for protective hose




Fig. 26: Connection diagram of the ULM level meter (variant -I)




Fig. 27: Connection diagram of the ULM level meter with a voltage output (variant -U)




Fig. 28: Connection diagram of the level meter with an RS-485 output (variant -M)




Fig. 29: Connection diagram of the ULS sensor with S type output (two-state current switch 4 mA / 20 mA)

Type **ULM-53_-_-_-I-B(H)-_**

The positive supply pole +U is connected to the brown wire of the connected cable, the negative pole is connected to the blue wire of the connected cable.

Type **ULM-53_-_-_-U-B(H)-_**

The positive supply pole +U is connected to the brown wire of the connected cable, the negative pole is connected to the blue wire of the connected cable. Output voltage is connected to the black wire of the cable.

Type **ULM-53_-_-_-M-B(H)-_**

Level meters are designed for connection to the PLC input (RS-485). The positive supply pole +U is connected to the brown wire of the connected cable, the negative pole is connected to the blue wire of the connected cable. Terminals A and B of line RS-485 are connected to the yellow and green communication wires. The ground terminal of line RS-485 is connected to cable shielding.

Type **ULS-53_-_-_-S-B(H)-_**

The positive supply pole +U is connected to the brown wire of the connected cable, the negative pole is connected to the blue wire of the connected cable.

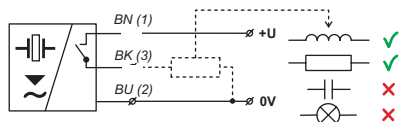


Fig. 30: Connection diagram of the ULS sensor with P type output (PNP) with an open collector

Type **ULS-53_ _ _ _-P-B(H)-_**

The positive supply pole +U is connected to the brown wire of the connected cable, the negative pole is connected to the blue wire of the connected cable. Load is connected to the black wire of the cable.

legend:

BK – black WH – white
 BU – blue YE – yellow
 BN – brown GN – green



Wiring operations shall only be carried out without voltage!

Taking into account the potential occurrence of electrostatic discharge on non-conducting parts of the level meter, it is necessary to ground the flange of level meters ULM-53Xi-20-F and sensors ULS-53Xi-20-F, located in an explosive atmosphere, using a ground terminal!



It is also necessary to design and take measures to reduce the effects of static electricity to a safe level in the wiring.

Installation in explosive atmospheres needs to be carried out in compliance with EN 60079-14 (Electrical installations for explosive gaseous atmospheres – Part 14: Electrical installations in dangerous areas other than mining) and possibly also in compliance with other standards relating to the area concerned.



The supply source should be preferably designed as a stabilized source of safe voltage 18 V to 36 V DC (max. 30 VDC for version Xi), which is part of the downstream processing or display system.

In case of strong ambient electromagnetic disturbance, parallel run of the input cable with the power line or its length exceeding 30 m, we recommend using a shielded cable.

10. SET-UP ELEMENTS

Device type with setting using buttons

Valid for: UL_53_ _ _ _-T

DOWN button for ULM (or "OFF" for ULS)

- open the setting mode
- for ULM: direct setting of the value 4 mA (0V)
- for ULS: setting limit for output disconnection
- decrease of values in defined steps

UP button for ULM (or "ON" for ULS)

- open the setting mode
- for ULM: direct setting of the value 20 mA (10V)
- for ULS: setting limit for output connection
- increase of values in defined steps

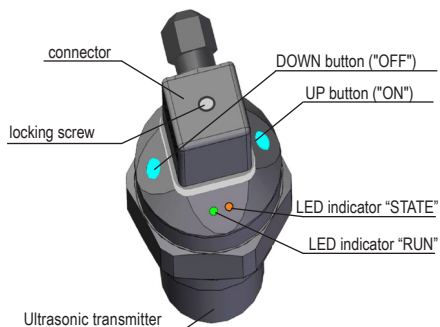


Fig. 31: Key parts of the measuring device (version with buttons)

Device type with setting using a magnetic pen

Valid for: UL_-53_-_-_-_-_-M

EMPTY flat area for ULM (or "OFF" for ULS)

- open the setting mode
- for ULM: direct setting of the value 4 mA (0 V)
- for ULS: setting limit for output disconnection

FULL flat area for ULM (or "ON" for ULS)

- open the setting mode
- for ULM: direct setting of the value 20 mA (10 V)
- for ULS: setting limit for output connection

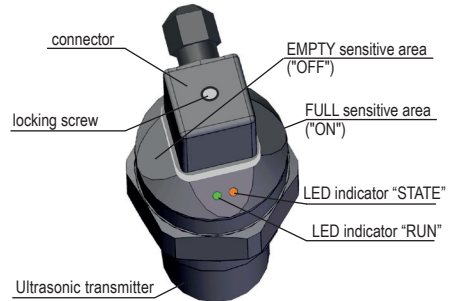


Fig. 32: Key parts of the measuring device (version with Hall probes)

11. STATUS INDICATION

LED indicator	Colour	Function
"RUN"	green	<p>short slow flashing (repeated depending on the measurement interval approx. 1 ... 2 s) - correct function, receipt of signal (echo) reflected from the measured surface</p> <p>fast flashing – the measured surface is in the dead zone of the level meter or the ultrasound transducer is dirty.* This fault signal is triggered after 5 measurements in dead zone. After one measuring outside out the dead zone the fault signal cancels (LED stops flashing rapidly and the current / voltage is set to the current level)</p> <p>off – the level meter is not capable of receiving the echo. Incorrect installation or malfunction.* This fault signal runs after 20 lost echoes. After one correct measurement the led starts flashing again and the current / voltage is set to the current level)</p> <p>(* The dead zone and failure are also indicated by setting the output current/ voltage see fault on page 25.</p>
"STATE"	orange	<p>ULM-53</p> <p>Setting indication</p> <ul style="list-style-type: none"> • slow flashing – 4 mA (0V) threshold setting indication • fast flashing – 20 mA (10V) threshold setting indication • 3 short flashes – setting confirmation <p>ULS-53</p> <p>Output status indication</p> <ul style="list-style-type: none"> • off – sensor output is disconnected (OFF) • on – sensor output is connected (ON) <p>Setting indication</p> <ul style="list-style-type: none"> • slow flashing – setting indication for the disconnected status • fast flashing – setting indication for the connected status • 3 short flashes – setting confirmation

12. SETTING

The level meter works most often in its default mode for level measurement (Fig. 33) and only rarely in the inverse mode (Fig. 34).

The manual device shall be set up after installation using the DOWN and UP buttons (for version "T") or by applying the magnetic pen onto sensitive flat areas (for version "M"). The set-up process is indicated by the STATE indicator lamp.

The L version level meter does not have any setting controls and indication LEDs. Pre-defined ranges are factory set (applicable to current and voltage outputs).

The level meter variant with a Modbus type output is set by means of two-way communication via the RS-485 industrial bus with the Modbus RTU protocol. A list of applicable registers is given in a separate appendix. To set up the level meter and collect measured data, you can use the software application „Basic SCADA level“, which is freely available at the Website www.dinel.cz.

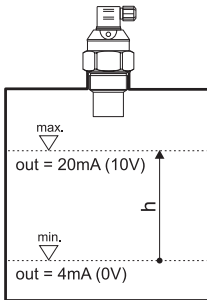


Fig. 33: Default mode
(level measurement)

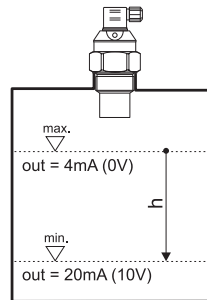


Fig. 34: Inverse mode

12.1. SETTING PROCEDURE FOR LEVEL METERS ULM-53

Connect the level meter to the supply source. Check the output value - current or voltage - using the measuring device or a connected instrument.

12.1.1. **Setting using buttons** (version "T")

a) Basic mode (level measurement)

Setting of lower limit 4 mA (0V)

1. Drain the tank to the lower measured surface level.
2. Press the DOWN button for at least 2 s to activate the setting mode (the STATE indicator LED flashes slowly). Keep the DOWN button pressed for at least additional 3 s to set the value to 4 mA (0V) directly. In that case you can skip step 3.
3. Press the DOWN and UP buttons to accurately set any value in individual increments (hold the relevant button to increase the adjustment step gradually).
4. Press both buttons simultaneously for at least 1 s to confirm the set values. The STATE indicator LED briefly flashes three times.
5. Any other setting is possible 2 s after both buttons are released.

Setting of upper limit 20 mA (10V)

1. Fill the tank up to the upper measured surface level.
2. Press the UP button for at least 2 s to activate the setting mode (the STATE indicator LED flashes quickly). Keep the UP button pressed for at least additional 3 s to set the value to 20 mA (10V) directly. In that case you can skip step 3.
3. Press the DOWN and UP buttons to accurately set any value in individual increments (hold the relevant button to increase the adjustment step gradually).
4. Press both buttons simultaneously for at least 1 s to confirm the set values. The STATE indicator LED briefly flashes three times.
5. Any other setting is possible 2 s after both buttons are released.

Factory default settings

1. Disconnect the level meter from supply voltage (e.g. by disconnecting the connector).
2. Press the DOWN and UP buttons at the same time while supply voltage is disconnected.
3. Connect supply voltage while keeping the DOWN and UP buttons pressed.
4. Wait approx. 4 s for 3 short flashes of the orange STATE indicator LED. After that, release both buttons.
5. Now the level meter is restored into factory default settings. See the table on page 25.

b) Inverse mode

In the inverse mode, set the lower limit of 4 mA (0 V) when the tank is filled up to the upper measured surface level and the upper limit of 20 mA (10 V) when the tank is drained to the lower measured surface level see Fig. 32.

12.1.2. Setting using a magnetic pen (version “M”)

a) Basic mode (*level measurement*)

Setting of lower limit 4 mA (0 V)

1. Drain the tank to the lower measured surface level.
2. Set the level meter output to the value of 4 mA (0 V) by applying the magnetic pen to the EMP-TY sensitive area for at least 2 s. The STATE indicator LED flashes slowly. Hold the magnetic pen on the flat area for at least additional 3 s to confirm the set value and store it in the internal memory of the level meter. The STATE indicator LED briefly flashes three times.
3. Any other setting is possible 2 s after the magnetic pen is removed from the sensitive area.

Setting of upper limit 20 mA (10 V)

1. Fill the tank up to the upper measured surface level.
2. Set the level meter output to the value of 20 mA (10 V) by applying the magnetic pen to the FULL sensitive area for at least 2 s. The STATE indicator LED flashes slowly. Hold the magnetic pen on the flat area for at least additional 3 s to confirm the set value and store it in the internal memory of the level meter. The STATE indicator LED briefly flashes three times.
3. Any other setting is possible 2 s after the magnetic pen is removed from the sensitive area.

Factory default settings

1. Disconnect the level meter from supply voltage (e.g. by disconnecting the connector).
2. While there is no supply voltage, apply the magnetic pen on one of the sensitive areas.
3. Connect supply voltage and keep the magnetic pen in position.
4. Wait approx. 4 s for 3 short flashes of the orange STATE indicator LED. You can remove the magnetic pen.
5. Now the level meter is restored into factory default settings. See the table on page 25.

b) Inverse mode

In the inverse mode, set the lower limit of 4 mA (0 V) when the tank is filled up to the upper measured surface level and the upper limit of 20 mA (10 V) when the tank is drained to the lower measured surface level see Fig. 32.

12.2. SETTING PROCEDURE FOR LEVEL SENSORS ULS-53

The ULS-53 sensor can work in two modes:

a) Mode O (closed output when the maximum level is exceeded)

- the sensor output is closed when the level rises to the upper set point and open when the level drops to the lower set point

b) Mode C (open output when the maximum level is exceeded)

- the sensor output is open when the level rises to the upper set point and closed when the level drops to the lower set point

Connect the sensor to the power supply. Check the status of the sensor output - connected or disconnected - using a connected device.

12.2.1. **Setting using buttons** (version "T")

a) Mode O (*closed output when the maximum level is exceeded*)

Setting of open output

1. Drain the tank to the lower measured surface level.
2. Open the sensor output by pressing the OFF button for at least 2 s. The STATE indicator LED flashes slowly. Keep the OFF button pressed for at least additional 3 s to confirm the set value and store it in the internal memory of the level meter. The STATE indicator LED briefly flashes three times. You can also press both buttons simultaneously for at least 1 s to confirm the set values.
3. Any other setting is possible 2 s after the button is released (buttons are released).

Setting of closed output

1. Fill the tank up to the upper measured surface level.
2. Closed the sensor output by pressing the ON button for at least 2 s. The STATE indicator LED flashes quickly. Keep the ON button pressed for at least additional 3 s to confirm the set value and store it in the internal memory of the level meter. The STATE indicator LED briefly flashes three times. You can also press both buttons simultaneously for at least 1 s to confirm the set values.
3. Any other setting is possible 2 s after the button is released (buttons are released).

Factory default settings

1. Disconnect the sensor from supply voltage (e.g. by disconnecting the connector).
2. Press the OFF and ON buttons at the same time while supply voltage is disconnected.
3. Connect supply voltage while keeping the OFF and ON buttons pressed.
4. Wait approx. 4 s for 3 short flashes of the orange STATE indicator LED. After that, release both buttons.
5. Now the level meter is restored into factory default settings. See the table on page 25.

b) Mode C (*open output when the maximum level is exceeded*)

In mode C, set the open status when the tank is filled up to the upper measured surface level and the closed status when the tank is drained to the lower measured surface level.

12.2.2. Setting using a magnetic pen (version “M”)

a) Mode O (*closed output when the maximum level is exceeded*)

Setting of disconnected output

1. Drain the tank to the lower measured surface level.
2. Open the sensor output by placing the magnetic pen to the OFF sensitive area for at least 2 s. The STATE indicator LED flashes slowly. Hold the magnetic pen on the OFF flat area for at least additional 3 s to confirm the set value and store it in the internal memory of the level meter. The STATE indicator LED briefly flashes three times.
3. Any other setting is possible 2 s after the magnetic pen is removed from the sensitive area.

Setting of connected output

1. Fill the tank up to the upper measured surface level.
2. Closed the sensor output by placing the magnetic pen to the ON sensitive area for at least 2 s. The STATE indicator LED flashes quickly. Hold the magnetic pen on the ON flat area for at least additional 3 s to confirm the set value and store it in the internal memory of the level meter. The STATE indicator LED briefly flashes three times.
3. Any other setting is possible 2 s after the magnetic pen is removed from the sensitive area.

Factory default settings

1. Disconnect the sensor from supply voltage (e.g. by disconnecting the connector).
2. While there is no supply voltage, place the magnetic pen on one of the sensitive areas.
3. Connect supply voltage and keep the magnetic pen in position.
4. Wait approx. 4 s for 3 short flashes of the yellow STATE indicator LED. After that, release both buttons.
5. Now the level meter is restored into factory default settings. See the table on page 25.

b) Mode C (*open output when the maximum level is exceeded*)

In mode C, set the open status when the tank is filled up to the upper measured surface level and the closed status when the tank is drained to the lower measured surface level.




If the surface level is within the dead zone (the RUN indicator LED flashes quickly), the setting mode is terminated immediately and will be inaccessible until the level leaves the dead zone.

If no button is pressed in the setting mode within 20 s, the measurement mode of the level meter will be restored. The newly set values will not be saved.

13. PROTOCOL MODBUS®


Data communication takes place along a series line of a standard RS-485 with protocol Modbus RTU. A list of relevant variables is provided in a separate annex.

To set up the level meter and collect measured data, you can use the software application „Basic SCADA level“, which is freely available at the Website www.dinel.cz. Connecting the level meter to a peripheral device can be performed using a converter URC-485, see image 35.

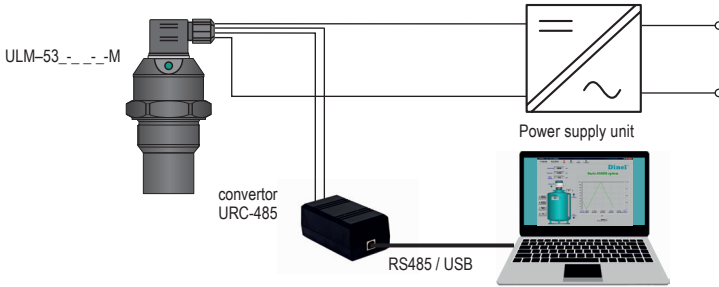

Obr. 35: Typical hardware configuration with Modbus®

14. ORDER CODE

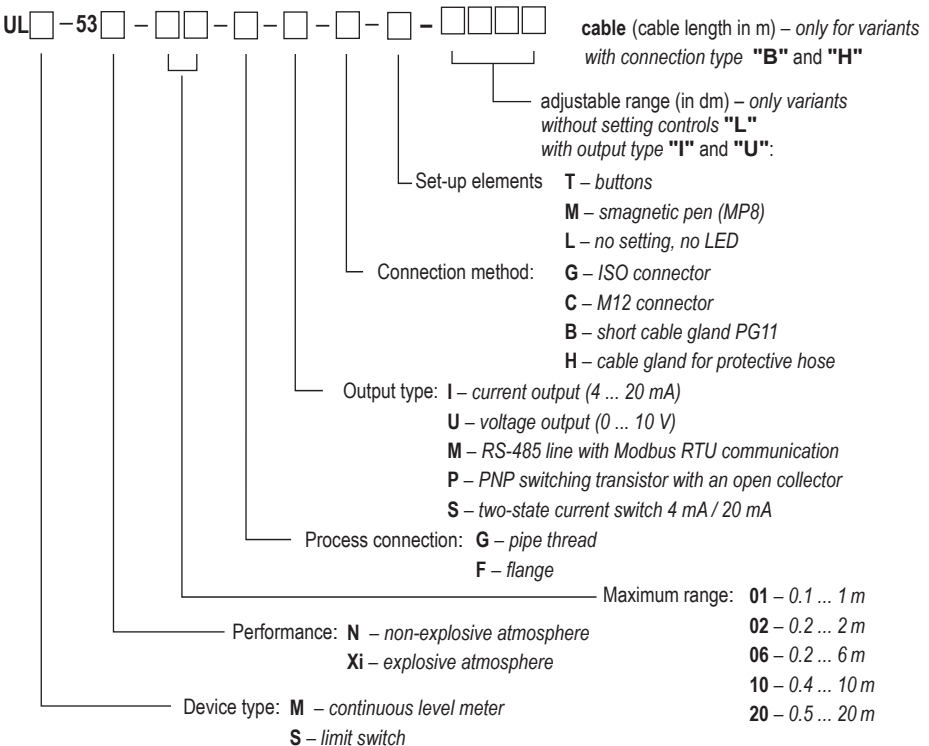

15. ACCESSORIES

standard

(included in device price)

- 1x seal (for UL_–53_– 01; 02; 06, 10)
- 1x connector with IP67 coverage (for versions with an ISO connector)
- 1x magnetic pen MP–8 (for device type adjusted with a magnetic pen)
- free-to-download programme Basic Scada Level (for the Modbus version)

optional

(for a extra charge)

- stainless steel or plastic fastening nuts G ¾", G1", G1 ½" and G2 ¼
- stainless steel or plastic lugs G ¾", G1", G1 ½" and G2 ¼
- horn adapter ST–G0,75 , ST–G1 (thread G1"), ST–G1,5 and ST–G2,25
- socket ELWIK A 4012 K PG7
- connector with IP67 coverage (type GAN-DADE 7A) with 5m cable (for current output and ISO type connector)
- connector with IP67 coverage (type GAN-DAEE 7A) with 5m cable (for voltage output and ISO type connector)
- converter URC-485 (for the Modbus version)

16. SAFETY, PROTECTION, COMPATIBILITY AND EXPLOSION-PROOF DESIGN

The ULM-53 level meter and the ULS-53 sensor are equipped with protection against reverse polarity of the supply voltage and against short voltage surges and with protection against current overload at the output.

Protection against dangerous contact is provided by low safe voltage under EN 33 2000-4-41.

Electromagnetic compatibility complies with EN 55011/B, EN 61326-1 and EN 61000-4-2 to 6.

The explosion-proof design of types ULM–53Xi and ULS-53Xi is provided in conformity to the standards: EN 60079-0 : 2007; EN 60079-11 : 2007 and EN 60079-26 : 2007.

Explosion-proof design is certified by FTZÚ–AO 210 Ostrava–Radvanice, Report No.: FTZÚ 09 ATEX 0119X.

A declaration of conformity has been issued for this device in accordance with Act No. 22/1997 Coll., as amended. The supplied electrical device conforms to the applicable government regulations concerning safety and electromagnetic compatibility.

Special conditions for the safe use of variants ULM–53Xi and ULS-53Xi

The device is designed for connection to isolating repeater IRU–420. When another approved supply unit whose output parameters meet the above-mentioned output parameters is used, it is necessary to provide galvanic separation or, if a supply unit without galvanic separation (Zener barriers) is used, it is necessary provide potential equalization between the sensor and the grounding point of the barrier.

For application in zone 0, the present explosive atmosphere, comprising a mixture of air with gases, vapour or mists, shall comply with: $0.8 \text{ bar} \leq p \leq 1.1 \text{ bar}$.

It is necessary to ground the flange in variants ULM-53Xi-20-F-I and ULS-53Xi-20-F-I using a ground terminal located on the flange.



The device shall be installed in a way to prevent mechanical damage to the sensor face.

17. USE, OPERATION AND MAINTENANCE

The ULM-53 level meter and the ULS-53 sensor do not require any maintenance for operation. During operation, the operators of the technology are informed of the level height of the measured material through a connected display unit.

Maintenance of the device consists in verification of integrity of the device and the supply cable. Depending on the nature of the material measured, we recommend to verify the cleanliness of the emitting flat area of the ultrasound transducer at least once per year and to clean it, if required. In case any visible defects are discovered, the manufacturer or reseller of this equipment shall be contacted immediately.



It is forbidden to perform any modifications or interventions into the ULM–53 level meter and the ULS–53 sensor without the manufacturer’s approval. Repairs, if any, shall only be done at the manufacturer or authorized service organization.



Assembly, installation, commissioning, operation and maintenance of the ULM–53 level meter and the ULS–53 sensor shall be carried out in accordance with this User's Guide; the provisions of standards in force regarding the installation of electrical equipment shall be adhered to.

Assembly, installation, commissioning, operation and maintenance in explosive atmospheres shall be carried out in compliance with EN 60079-14 (Electrical installations for explosive gaseous atmospheres – Part 14: Electrical installations in dangerous areas other than mining) and possibly also in compliance with other standards relating to the area concerned.

18. GENERAL CONDITIONS AND WARRANTY


Starting from the delivery, the manufacturer guarantees that this product will maintain the properties specified in the specifications for 3 years. The manufacturer is responsible for defects identified during the warranty period and claimed in writing.

The warranty does not cover defects due to improper handling or failure to comply with the specifications. The warranty shall expire if the buyer or a third party makes modifications or adjustments to the product, if the product is damaged mechanically or chemically or if the serial number is illegible. The warranty certificate shall be submitted for a successful claim.

If the claim turns out to be justified, we will repair or replace the defective product. In both cases, the warranty period shall be extended by the period of remedy.

19. MARKING OF LABELS

Labels for device type ULM-53 _ _ _ _ _ :



Sample label for device type ULM-53Xi-02-G-I-C-T

manufacturer's symbol: Dinel® logo

Internet address: www.dinel.cz

country of origin: Made in Czech Republic

connection diagram and marking of wires: U, 0V (for ULM-53N current output); U_i, 0V (for ULM-53Xi)
+U, U_{out}, 0V (for ULM-53N voltage output); +U, 0V, A, B (for Modbus)

level meter type: ULM-53 _ _ _ _ _

product serial number: Ser. No.: xxxxx - (from left: year of manufacture, serial production No.)

output current range: I = 4 ... 20 mA or output voltage range: U_{out} = 0 ... 10 V

supply voltage range: U = 18 ... 36 mA (applies to version ULM-53N)

limit parameters: U_i = 30 V =, I_i = 132 mA; P_i = 0,99 W; C_i = 370 nF; L_i = 0,9 mH (applies to version ULM-53Xi)

working temperature range: t_a = -30 ... + _ °C (Temperature range according to the type)

mark of non-explosive device: (applies to version ULM-53Xi)

design: II _ G Ex ia IIB T5 _ _ , see Classification of non-explosive design (applies to version ULM-53Xi)


number of certificate of intrinsic safety: FTZÚ 09 ATEX 0119X (applies to version ULM-53Xi)

coverage: IP67 or IP68, conformity mark:

number of authorized person supervising over the quality system: 1026 (applies to version ULM-53Xi)

electric waste take-back system mark:

Labels for device type ULS-53 _ _ _ _ _ :



Sample label for device type ULS-53N-02-G-P-G-T

manufacturer's symbol: Dinel® logo

Internet address: www.dinel.cz

country of origin: Made in Czech Republic

connection diagram and marking of wires: +U, 0V (for version ULS-53N); +U_i, 0V (for version ULS-53Xi)

level meter type: ULS-53 _ _ _ _ _

product serial number: Ser. No.: xxxxx - (from left: year of manufacture, serial production No.)

output current range: I = 4 ... 20 mA

supply voltage range: U = 18 ... 36 mA (applies to version ULS-53N)

maximum switch current: I_{omax} = 300 mA

limit parameters: U_i = 30 V =, I_i = 132 mA; P_i = 0,99 W; C_i = 370 nF; L_i = 0,9 mH (applies to version ULS-53Xi)

working temperature range: t_a = -30 ... + _ °C (Temperature range according to the type)

mark of non-explosive device: (applies to version ULS-53Xi)

design: II _ G Ex ia IIB T5 _ _ , see Classification of non-explosive design (applies to version ULS-53Xi)

number of certificate of intrinsic safety: FTZÚ 09 ATEX 0119X (applies to version ULS-53Xi)

coverage: IP67 or IP68, conformity mark:

number of authorized person supervising over the quality system: 1026 (applies to version ULS-53Xi)

electric waste take-back system mark:

20. SPECIFICATIONS

TECHNICAL DATA - LEVEL METER / SENSOR		
Measurement range ¹⁾	UL_-53_-01-_ UL_-53_-02-_ UL_-53_-06-_ UL_-53_-10-_ UL_-53_-20-_	0.10 ... 1 m 0.20 ... 2 m 0.20 ... 6 m 0.4 ... 10 m 0.5 ... 20 m
Current consumption	ULM-53N(Xi)-_-_-I ULM-53N-_-_-U ULM-53N-_-_-M ULS-53N-_-_-P ULS-53N(Xi)-_-_-S	4 ... 20 mA / max. 22 mA max. 12 mA max. 20 mA max. 12 mA disconnected 4 mA / connected 20 mA
Power supply voltage	ULM-53N and ULS-53N ULM-53Xi and ULS-53Xi	18 ... 36 V DC 18 ... 30 V DC
Output	ULM-53_-_-I ULM-53N-_-_-U ULM-53N-_-_-M ULS-53N-_-_-P ULS-53_-_-S	4 ... 20 mA (limit values 3.9 ... 20.5 mA) 0 ... 10 V (limit values 0 ... 10,2 V) RS-485 line with Modbus RTU PNP transistor with an open collector (max. switch current 300 mA) two-state current switch 4 mA / 20 mA
Resolution		< 1 mm
Measurement accuracy (of the total range)	UL_-53_-01 in the area 0.1 –0.2 m / 0.2 –1.0 m UL_-53_-02; -06 UL_-53_-10; -20	0.3% / 0.2% 0.15% 0.2%
Temperature error		max. 0.04% / K
Beamwidth (-3 dB)	UL_-53_-01-_-; 02-_-; 10-_- UL_-53_-06-_- UL_-53_-20-_-	10° 14° 12°
Max. ambient temperature range	UL_-53_-01-_-; 02-_-; 06-_- UL_-53_-10-_-; 20-_-	-30 ... +70°C -30 ... +60°C
Short time temperature stress resistance		+90°C / 1 hour
Measuring period	UL_-53_-01-_-; 02-_- UL_-53_-06-_-; 10-_- UL_-53_-20-_- UL_-53_-_-_-M	0.5 s 1.2 s 5.0 s adjustable through Modbus RTU
Averaging	UL_-53_-_-_- ULM-53_-_-_-M	4 measurements ³⁾ adjustable through Modbus RTU
Maximum operating overpressure (on transmission surface)		0.1 MPa
Limit operating parameters ²⁾ (for the Xi version only)		U _i =30V DC; I _i =132mA; P _i =0.99W; C _i =370nF; L _i =0.9mH
Failure indication	echo failure – default mode echo failure – inverse mode level in dead zone ⁴⁾ – default mode level in dead zone ⁴⁾ – inverse mode	3.75 mA / 0 V / Modbus RTU 22 mA / 10.5 V / Modbus RTU 22 mA / 10.5 V / Modbus RTU 3.75 mA / 0 V / Modbus RTU
Protection class	- UL_-53_-_-_-_- T	IP67
	- UL_-53_-_-_-_- G-M, L	
	- UL_-53_-_-_-_- C-M, L	IP67 ⁵⁾
	- UL_-53_-_-_-_- B-M, L	
	- UL_-53_-_-_-_- H-M, L	IP68
Tightening torque for cable gland		3 Nm

¹⁾ Applicability for measuring the surface level of loose materials is limited, the range of measurement is shorter there.

²⁾ Permitted range of pressures in the area of zone 0 (design Xi): 80 ... 110kPa.

³⁾ From the last six measurements are taken out extreme values MAX and MIN, then the remaining four measurement was performed arithmetic average

⁴⁾ Dead zone = blind zone = blocking zone.




TECHNICAL DATA - LEVEL METER

Recommended cable	ULM-53__-__-I ; ULS-53__-__-S ULM-53N__-__-U ; ULS-53N__-__-P ULM-53N__-__-M	PVC 2 x 0.75 mm ² PVC 3 x 0.50 mm ² PVC 2x2, 0,25 mm ²
Maximum load resistance of current output at	U = 24 V DC U = 22 V DC U = 20 V DC	R _{max} = 270 Ω ³⁾ R _{max} = 180 Ω R _{max} = 90 Ω
Minimum load resistance of voltage output		R _{min} > 1 kΩ
Delay between supply power rise time and first measurement	UL_-53_-01_-__ ; 02_-__ ; 06_-__ UL_-53_-10_-__ ; 20_-__	5 s 9 s
Process connection	UL_-53_-01_-__ UL_-53_-02_-__ UL_-53_-06_-__ UL_-53_-10_-__ UL_-53_-20_-__	fitting with thread G ¾" fitting with thread G 1" fitting with thread G 1½ " fitting with thread G 2¼" flange of Al alloy
Weight	UL_-53_-01_-__ UL_-53_-02_-__ UL_-53_-06_-__ UL_-53_-10_-__ UL_-53_-20_-__	approx. 0.20 kg approx. 0.20 kg approx. 0.25 kg approx. 0.65 kg approx. 2.80 kg

MATERIALS

sensor part	type variant	standard material
Housing	all	plastic PP
Electro-acoustic transducer	all	plastic PVDF
Flange	UL_-53_-20	lacquered aluminum alloy
Cable gland	all	plastic PA

AREA CLASSIFICATION (under ČSN EN 60079-10 and ČSN EN 60079-14)

UL_-53N_-__-__	basic design for non-explosive atmospheres
ULM-53Xi-01(02, 06)-__-I ULS-53Xi-01(02, 06)-__-S	intrinsically safe design for areas with the risk of explosion of flammable vapours and gases  II 1/2G Ex ia IIB T5 Ga/Gb with isolating repeater ¹⁾ , entire level meter - zone 1, front head part - zone 0
ULM-53Xi-10-__-I ULS-53Xi-10-__-S	intrinsically safe design for areas with the risk of explosion of flammable vapours and gases  II 1/2G Ex ia IIA T5 Ga/Gb with isolating repeater ¹⁾ , entire level meter - zone 1, front head part - zone 0
ULM-53Xi-20-__-I ULS-53Xi-20-__-S	intrinsically safe design for areas with the risk of explosion of flammable vapours and gases  II 2G Ex ia IIA T5 Gb with isolating repeater ¹⁾ , entire level meter - zone 1

¹⁾ Intrinsically safe isolating repeater (e.g. Dinel IRU-420).

FACTORY DEFAULT TABLE

	ULM-53_-01	ULM-53_-02	ULM-53_-06	ULM-53_-10	ULM-53_-20
Minimum range (20 mA)	0.10 m	0.20 m	0.20 m	0.4 m	0.5 m
Maximum range (4 mA)	1 m	2 m	6 m	10 m	20 m
	ULS-53_-01	ULS-53_-02	ULS-53_-06	ULS-53_-10	ULS-53_-20
Connection level (ON)	0.45 m	0.90 m	2.7 m	4.5 m	9 m
Disconnection level (OFF)	0.65 m	1.30 m	3.9 m	6.5 m	13 m

Dinel[®]

industrial electronics

Dinel, s.r.o.

U Tescomy 249
760 01 Zlín
Czech Republic

Phone: +420 577 002 002

Fax: +420 577 002 007

Email: sale@dinel.cz

www.dinel.cz

You can find the current version of the User's Guide at www.dinel.cz.

1/2017



QMS
ISO 9001

